



TC-12119  
Telephone:0484-2623576  
email:-qcclaluva@gmail.com

**KERALA WATER AUTHORITY**  
**QUALITY CONTROL DISTRICT LAB,ALUVA -683101**  
**WATER TEST REPORT**

ULR NO:TC121192600000629F

Report No: KWA/QCDL-ALY/S/629/05/26-27


Report Issue Date: 19.05.2026

Customer Name &Address  ASSISI VIDYANIKETAN PUBLIC SCHOOL, ATTIPETTY NAGAR, CHEMBUMUKKU KAKKANAD KOCHI 682021	Date of Receipt of Payment	08.05.2026
	Date of Sample received	11.05.2026
	Sample given by	MO I/C UPHC Thrikkakara
	Sample Code	ALY/S/629/05/26-27
	Sample Name	Drinking Water
	Sample Condition	Fit For Analysis
	Source of Sample	Well
	Sample Quantity	2 Litre
Test performing dates : From :15.05.26 to 16.05.26		

Sl.N	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500-2012	Result
1	Turbidity	NTU	IS 3025 (Part 10)-2023 Nephelometric method	1.0	1.3
2	pH at 25°C	-	IS 3025 (Part 11)-2022 Electrometric method	6.5 to 8.5	7.66
3	Total Hardness (as CaCO3)	mg/L	IS 3025 (Part21)-2009(Reaffirmed 2023) EDTA titration method	200	29.4
4	Chloride (as Cl)	mg/L	IS 3025 (Part 32)-2025 Argentometric titration	250	9.50
5	Iron (as Fe)	mg/L	IS 3025 (Part 53) – 2024 1,10 phenanthroline method	1	0.22
6	Nitrate (as NO3)	mg/L	APHA 24th Edition-4500-NO3 Method B(UV Spectrophotometric Screening Method)	45	1.47
7	Electrical conductivity at 25°C	micromhos/cm	IS 3025 (Part 14)- 2013 (Reaffirmed 2023) Electrometric method	-	59.00

Remarks:- DL : Detectable Limit  
BDL : Below Detectable Limit

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .  
2) The samples retain for 15 days from the end date of analysis  
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

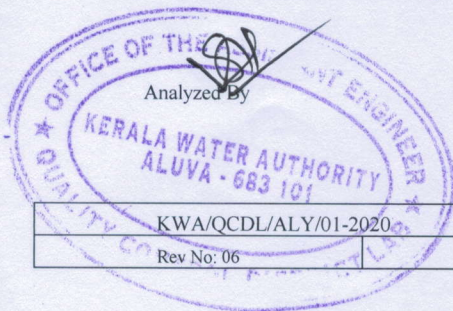

Reviewed By

Authorized By

End of Report

KWA/QCDL/ALY/01-2020	Issue Date: 19.05.2026
Rev No: 06	Page 1 of 2

Rev,Date : 15/07/2025

**QUALITY MANAGER**  
**KWA, QUALITY CONTROL DISTRICT LAB**  
**ERNAKULAM, ALUVA - 683 101**



TC-12119  
Telephone:0484-2623576  
email:-qcldaluva@gmail.com

**KERALA WATER AUTHORITY**  
**QUALITY CONTROL DISTRICT LAB,ALUVA -683101**  
**WATER TEST-BACTERIOLOGY REPORT**

Report No: ALY/B/634

Report Issue Date: 19.05.2026

<b>Customer Name &amp;Address</b>		<b>Date of Receipt of Payment</b>	08.05.2026	
ASSISI VIDYANIKETAN PUBLIC SCHOOL, ATTIPETTY NAGAR, CHEMBUMUKKU KAKKANAD KOCHI 682021		<b>Date of Sample received</b>	11.05.2026	
		<b>Sample given by</b>	MO I/C UPHC Thrikkakara	
		<b>Sample Code</b>	ALY/B/634	
		<b>Sample Name</b>	Drinking Water	
		<b>Sample Condition</b>	Fit For Analysis	
		<b>Source of Sample</b>	Well	
		<b>Sample Quantity</b>	250ml	
		<b>Test performing dates :</b>		From :11.05.26 to 12.05.26
<b>Sl. No.</b>	<b>Parameter</b>	<b>Acceptable Limit as per IS 10500-2012</b>	<b>Test Method</b>	<b>Result</b>
1	Total Coliform	Shall not be Detected/100ml	IS15185-2016 (Reaffirmed 2021)	Absent/100 ml
2	E-Coli	Shall not be Detected/100ml	IS15185-2016 (Reaffirmed 2021)	Absent/100 ml


- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .  
2) The samples retain for 4 days from the end date of analysis  
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By

Authorized By Quality Manager

End of Report

KWA/OC/DL/ALY/01-2020	Issue Date : 04.10.2020
Rev No: 06	Rev.Date : 15/07/2025
Page 2 of 2	

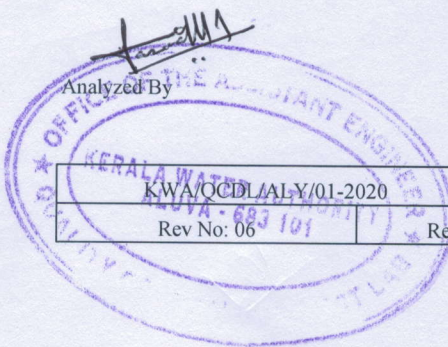

KWA QUALITY ERNAK

OTTABE 3701



TC-12119  
Telephone:0484-2623576  
email-qcdlaluva@gmail.com

**KERALA WATER AUTHORITY**  
**QUALITY CONTROL DISTRICT LAB,ALUVA -683101**  
**WATER TEST REPORT**

ULR NO:TC12119260000630F

Report No: KWA/QCDL-ALY/S/630/05/26-27

Report Issue Date: 19.05.2026

Customer Name & Address  ALPHA DALE ASSISI NURSERY SCHOOL ATTIPETTY NAGAR,CHEMBUMUKKU KAKKANAD, KOCHI 682021	Date of Receipt of Payment	08.05.2026
	Date of Sample received	11.05.2026
	Sample given by	MO I/C UPHC Thrikkakara
	Sample Code	ALY/S/630/05/26-27
	Sample Name	Drinking Water
	Sample Condition	Fit For Analysis
	Source of Sample	Well
	Sample Quantity	2 Litre
	Test performing dates : From :15.05.26 to 16.05.26	

SL.N	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500-2012	Result
1	Turbidity	NTU	IS 3025 (Part 10)-2023 Nephelometric method	1.0	0.16
2	pH at 25°C	-	IS 3025 (Part 11)-2022 Electrometric method	6.5 to 8.5	7.68
3	Total Hardness (as CaCO3)	mg/L	IS 3025 (Part21)-2009(Reaffirmed 2023) EDTA titration method	200	33.6
4	Chloride (as Cl)	mg/L	IS 3025 (Part 32)-2025 Argentometric titration	250	10.50
5	Iron (as Fe)	mg/L	IS 3025 (Part 53) – 2024 1,10 phenanthroline method	1	0.1
6	Nitrate (as NO3)	mg/L	APHA 24th Edition-4500-NO3 Method B(UV Spectrophotometric Screening Method)	45	1.17
7	Electrical conductivity at 25°C	micromhos/cm	IS 3025 (Part 14)- 2013 (Reaffirmed 2023) Electrometric method	-	68.00

Remarks:- DL : Detectable Limit  
BDL : Below Detectable Limit


- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .  
2) The samples retain for 15 days from the end date of analysis  
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By

Reviewed By

Authorized By

End of Report

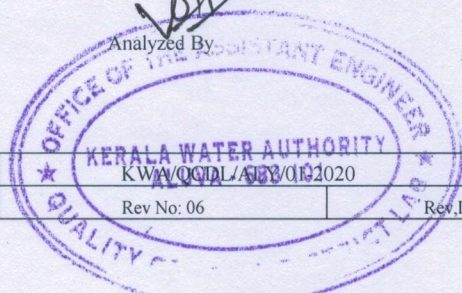 KWA/QCDL/ALY/05/26-27 Rev No: 06	Issue Date : 04.10.2020
	Page 1 of 2

QUALITY MANAGER  
KWA QUALITY CONTROL DISTRICT LAB  
ERNAKULAM



TC-12119  
Telephone:0484-2623576  
email:-qcdlaluva@gmail.com

**KERALA WATER AUTHORITY**  
**QUALITY CONTROL DISTRICT LAB,ALUVA -683101**

**WATER TEST-BACTERIOLOGY REPORT**

Report No: ALY/B/635

Report Issue Date: 19.05.2026


<b>Customer Name &amp;Address</b>		<b>Date of Receipt of Payment</b>	08.05.2026	
ALPHA DALE ASSISI NURSERY SCHOOL ATTIPETTY NAGAR,CHEMBUMUKKU KAKKANAD, KOCHI 682021		<b>Date of Sample received</b>	11.05.2026	
		<b>Sample given by</b>	MO I/C UPHC Thrikkakara	
		<b>Sample Code</b>	ALY/B/635	
		<b>Sample Name</b>	Drinking Water	
		<b>Sample Condition</b>	Fit For Analysis	
		<b>Source of Sample</b>	Well	
		<b>Sample Quantity</b>	250ml	
		<b>Test performing dates :</b>		From :11.05.26 to 12.05.26
<b>Sl. No.</b>	<b>Parameter</b>	<b>Acceptable Limit as per IS 10500-2012</b>	<b>Test Method</b>	<b>Result</b>
1	Total Coliform	Shall not be Detected/100ml	IS15185-2016 (Reaffirmed 2021)	Absent/100 ml
2	E-Coli	Shall not be Detected/100ml	IS15185-2016 (Reaffirmed 2021)	Absent/100 ml

NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .

2) The samples retain for 4 days from the end date of analysis

3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By

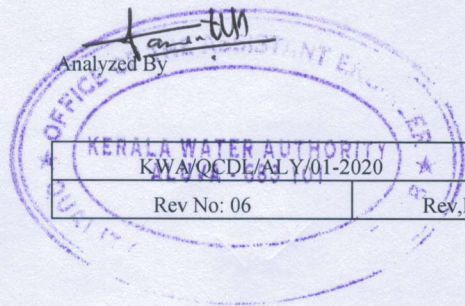

End of Report

Authorized By Quality Manager

**QUALITY MANAGER**  
**KWA, QUALITY CONTROL DISTRICT LAB**  
**ERNAKULAM**

KWA/QCDE/ALY/01-2020		Issue Date : 04.10.2020	
Rev No: 06	Rev,Date : 15/07/2025	Page 2 of 2	